

# **ME631 Three-phase Power Meter Communication Protocol**

## **V3.4**

Shanghai PINYAN M&C Technology Co., Ltd.  
2018.11

## Modbus communications overview

ME631 adopts standard protocol—Modbus-RTU. Baud rate of communication can change to 1200、2400、4800、9600 etc. through program . Error detection: CRC16 (cyclic redundancy check).

## Modbus communications settings

Before communicating with the device using Modbus-RTU protocol, use the HMI to configure the following settings:

Parameters	Available Values	Default Value
Baud rate	-1200 Baud -2400 Baud -4800 Baud -9600 Baud -19200 Baud -38400 Baud -57600 Baud	9600 Baud
Data bits	8	8
Parity	– Odd – Even – None	None
Stop bits	1	1
Address	1–247	1

## Command Request

Slave Address	Function Code	Command Block	CRC
8-Bits	8-Bits	Nx8-Bits	16-Bits Checking

## Functional code

Functional code tells what function addressed terminal equipment can execute. The following table lists the functional code that used by this instrument, as well as their significance and function.

Function Code		Function Name	Behavior
Decimal	Hexadecimal		
3	03H	Read Holding Registers	Read present HEX from one or more registers.
16	10H	Write Multiple Registers	Write present HEX on multiple registers.

## Register table

Register tables have the following columns:

Register Alias	Register Address	Action R/WC	Size	Type	Units	Description
----------------	------------------	-------------	------	------	-------	-------------

- **Register Alias:** The meaning of the register
- **Register Address:** Modbus address of register encoded in the Modbus frame, in decimal (dec)

- **Action:** The read/write by command register
- **Size:** The data size in Int16
- **Type:** The encoding data type
- **Units:** The unit of the register value
- **Range:** The permitted values for this variable, usually a subset of what the format allows
- **Description:** Provides information about the register and the values that apply

### Unit Table

The following data types appear in the Modbus register list:

Type	Description	Range
UInt16	16-bit unsigned integer	0–65535
Int16	16-bit signed integer	-32768–+32767
UInt32	32-bit unsigned integer	0–4 294 967 295
UInt64	64 bit unsigned integer	0–18 446 744 073 709 551 615
UTF8	8-bit field	multibyte character encoding for Unicode
Float32	32-bit value	Standard representation IEEE for floating number (with single precision)
Bitmap	–	–
Date Time	–	-

### Date Time Format:

Word	Units															
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
1	Reserved (0)								Year (0–99, year from 2000)							
2	Month (1–12)								Day (1–31)							
3	Hour (0–23)								Minute (0–59)							
4	Millisecond (0–59999)															

### Configure Meter

You can configure the power meter by writing command and command parameters to corresponding command registers using Modbus function 16.

### Command request

The following table describes a Modbus command request:

Slave Address ( 8 bits )	Function Code ( 8 bits )	Command Register Address ( 16 bits )		Command Register Number ( 16 bits )		Data Length ( 8 bits )	Command Register Value ( 16 bits ) X N				CRC ( 16bits )			
		High 8 bits	Low 8 bits	High 8 bits	Low 8 bits		Command		Parameter		Low 8 bits	High 8 bits		
1-247	16					Nx2	High 8 bits	Low 8 bits	High 8 bits	Low 8 bits				

### Command Result

The command result can be obtained by reading registers 424 and 425.

The following table describes the command result:

Register Address	Content	Size (Int16)	Data (example)
424	Requested Command Number	1	1001(set Date Time)
425	Result	1	0 = Valid Operation 80 = Invalid Command 81 = Invalid Parameter 82 = Invalid Number of Parameters 83= Operation Not Performed

### Command Request Example

Slave Address ( 8 bits )	Function Code ( 8 bits )	Command Register Address ( 16 bits )		Command Register Number ( 16 bits )		Data Length ( 8 bits ) N x 2	Command Register Value ( 16 bits ) x N				CRC ( 16bits )	
		High 8 bits	Low 8 bits	High 8 bits	Low 8 bits		Command		Command parameters		High 8 bits	Low 8 bits
							High 8 bits	Low 8 bits	High 8 bits	Low 8 bits		

### Function code ( 0x10=16 ) Operation

Function code ( 0x10=16 ) is used to configure meter, it requests and Responses data format

Request data format:

No.	Alias	Type	Range (decimal)	Description
1	Salve ID	UInt8	1-247	
2	Function code	UInt8	16	
3	Registers Start address	UInt16	-	Big-Endian (Sending order)
4	Registers Numbers	UInt16	1-123	Big-Endian (Sending order)
5	Bytes of Registers Values	UInt8		Registers Numbers *2
6	Value of Register 1	UInt16	-	Big-Endian (Sending order)
7	...	UInt16	-	Big-Endian (Sending order)
8	Value of Register n	UInt16	-	Big-Endian (Sending order)
9	CRC-16 Check	UInt16	-	Little-Endian (Sending order)

Response data format :

No.	Alias	Type	Range (decimal)	Description
1	Salve ID	UInt8	1-247	
2	Function code	UInt8	16	
3	Registers Start address	UInt16	300	Big-Endian
4	Registers Numbers	UInt16	1-123	Big-Endian
5	CRC-16 Check	UInt16	-	Little-Endian

**Attention!**

Function code ( 0x10=16 ) can only write data to “Command Register”, that is to say, only registers start from 300 can be written data.

For example :

Configure “Digital Outputs”(command=1005)

No.	Alias	Type	Range (decimal)	Range (hexadecimal)	Description
1	Salve ID	UInt8	1	01	
2	Function code	UInt8	16	10	
3	Registers Start address	UInt16	300	012C	Big-Endian (Sending order)
4	Registers Numbers	UInt16	2	0002	Big-Endian (Sending order)
5	Bytes of Registers Values	UInt8	4	04	
6	Value of Register 300	UInt16	1005	03ED	Big-Endian (Sending order)
7	Value of Register 301	UInt16	1	0001	Big-Endian (Sending order)
9	CRC-16 Check	UInt16	50093	C3AD	Little-Endian (Sending order)

Request data send as follows :

01 10 01 2C 00 02 04 03 ED 00 01 AD C3

if configure data is right, the meter will response data as follows :

01 10 01 2C 00 02 81 FD

No.	Alias	Type	Range (hexadecimal)	Range (decimal)
1	Salve ID	UInt8	01	1
2	Function code	UInt8	10	16
3	Registers Start address	UInt16	012C	300
4	Registers Numbers	UInt16	0002	2
7	CRC-16 Check	UInt16	81FD	

## Function code ( 0x03=3 ) Operation

Function code ( 0x03=3 ) is used to read registers values, it requests and Responses data format as

follows :

Request data format:

No.	Alias	Type	Range(decimal)	Description
1	Salve ID	UInt8	1-247	
2	Function code	UInt8	3	
3	Registers Start address	UInt16	-	Big-Endian (Sending order)
4	Registers Numbers	UInt16	1-125	Big-Endian (Sending order)
5	CRC-16 Check	UInt16	-	Little-Endian (Sending order)

Response data format :

No.	Alias	Type	Range(decimal)	Description
1	Salve ID	UInt8	1-247	
2	Function code	UInt8	3	
3	Bytes of Registers Values	UInt8	-	Registers Numbers *2
4	Value of Register 1		-	Big-Endian
5	...		-	Big-Endian
6	Value of Register n		-	Big-Endian
7	CRC-16 Check	UInt16	-	Little-Endian

For example :

Read Volatage A,B,C value ( Address starts 2147 )

No.	Alias	Type	Range (decimal)	Range (hexadecimal)	Description
1	Salve ID	UInt8	1	0x01	
2	Function code	UInt8	3	0x03	
3	Registers Start address	UInt16	2147	0x0863	
4	Registers Numbers	UInt16	6	0x0006	
5	CRC-16 Check	UInt16	46647	0xB637	

Request data send as follows :

01 03 08 63 00 06 37 B6

Response data as follows :

01 03 0C 43 5C 00 00 43 5D 00 00 43 5E 00 00 14 AC

No.	Alias	Type	hexadecimal	decimal
1	Salve ID	UInt8	01	1
2	Function code	UInt8	03	3
3	Bytes of Registers Values	UInt8	0C	12
4	Voltage A	float32	435C0000	220V
5	Voltage B	float32	435D0000	221V
6	Voltage C	float32	435E0000	222V
7	CRC-16 Check	UInt16	14AC	

## Exception Response

### Exception response frame format

No.	Alias	Type	Range (decimal)	Range (hexadecimal)	Description
1	Salve ID	UInt8	1-247	0x01-0xF7	
2	Function code	UInt8	(128+3) (128+16)	(0x80+0x03) (0x80+0x10)	
3	Exception code	UInt8			
4	CRC-16 Check	UInt16			Little-Endian

### Exception code of MODBUS

Code (hexadecimal)	Name	Meaning
0x01	ILLEGAL FUNCTION	The function code received in the query is not an allowable action for the meter
0x02	ILLEGAL DATA ADDRESS	The data address received in the query is not an allowable address for the meter
0x03	ILLEGAL DATA VALUE	A value contained in the query data field is not an allowable value for the meter
0x04	DEVICE FAILURE	An unrecoverable error occurred while the server was attempting to perform the requested action.

## Command List

### Set System Date Time

Command Number	Action R/W	Size	Type	Units	Range	Description
1001	W	1	UInt16	-	2000-2099	Year
	W	1	UInt16	-	1-12	Month
	W	1	UInt16	-	1-31	Day
	W	1	UInt16	-	0-23	Hour
	W	1	UInt16	-	0-59	Minute
	W	1	UInt16	-	0-59	Second

### Set Communications

Command Number	Action R/W	Size	Type	Units	Range	Description
1002	W	1	UInt16	-	1-247	Slave Address
	W	1	UInt16	-	0,1,2,3,4,5,6	Baud Rate 0=1200 1=2400 2=4800 3=9600 4=19200 5=38400 6=57600
	W	R/WC	UInt16	-	0,1,2	Parity 0 = ODD 1 = EVEN 2 = None

### Set Power System

Command Number	Action R/W	Size	Type	Units	Range	Description
1003	W	1	UInt16	-	0,1,2,3,4	Wiring 0 = 1PH2W L-N 1 = 1PH2W L-L 2 = 3PH4W 3 = 3PH3W 4= 1PH3W_LLN
	W	1	UInt16	Hz	50,60	Nominal Frequency
	W	2	UInt32	V	>0	VT Primary
	W	2	UInt32	V	>0	VT Secondary =RealValue*1000
	W	2	UInt32	A	>0	CT Primary



	W	2	UInt32	mV	>0	CT Secondary =RealValue*1000
	W	2	UInt32	A	>0	Rcoil Primary
	W	2	UInt32	mV	>0	Rcoil Secondary =RealValue*1000
	W	1	UInt16	-	0,1	Voltage Connection 0 = Direct Connect 1 = 3 VT
	W	1	UInt16	-	0,1	Current Connection 0 = Rogowski coil 1 = CT

### Set harmonic times

Command Number	Action R/W	Size	Type	Units	Range	Description
1004	W	1	UInt16	-	2-52	HX harmonic times
	W	1	UInt16	-	2-52	HY harmonic times
	W	1	UInt16	-	2-52	HZ harmonic times

### Set Digital Output

Command Number	Action R/W	Size	Type	Units	Range	Description
1005	W	1	UInt16	-	0,1	1 = Relay output on 0 = Relay output off

### Choose Tariff

Command Number	Action R/W	Size	Type	Units	Range	Description
1006	W	1	UInt16	-	1,2,3,4	1 = Tariff 1 2 = Tariff 2 3 = Tariff 3 4 = Tariff 4

### Reset Energy

Command Number	Action R/W	Size	Type	Units	Range	Description
2000	W	1	UInt16	-	100-103	100 : Reset Phase 1 101 : Reset Phase 2 102 : Reset Phase 3 103 : Reset Phase 1,2,3

### Reset Tariff Energy

Command Number	Action R/W	Size	Type	Units	Range	Description
2001	W	1	UInt16	-	200-204	200 : Reset Tariff 1 201 : Reset Tariff 2 202 : Reset Tariff 3 203 : Reset Tariff 4 204 : Reset Tariff 1,2,3,4

### Reset Peak Demand

Command Number	Action R/W	Size	Type	Units	Range	Description
2002	W	1	UInt16	-	1	1 : Reset Peak Demand

## Modbus Register List

### Meter

Register Alias	Register Address	Action R/W	Size	Type	Units	Description
Meter Model	50	R	20	UTF8	-	
Serial Number	70	R	2	UInt32	-	
Firmware Version	72	R	1	UInt16	-	DLF format: X.Y.ZTT
Date time	73	R/W	4	Date time	-	Date/Time Reg.73: Year00-99 (year from 2000 to 2099) Reg.74: Month (b15:b8), day (b7:b0) Reg. 75: Hour (b15:b8) ,Minute (b7:b0) Reg. 76: Millisecond

### Communications

Register Alias	Register Address	Action R/W	Size	Type	Units	Description
Address	80	R/W	1	UInt16	-	1-247
Baud Rate	81	R/W	1	UInt16	-	0=1200 1=2400 2=4800 3=9600 4=19200 5=38400 6=57600
Parity	82	R/W	1	UInt16	-	0 = ODD 1 = EVEN 2 = None

### Power System

Register Alias	Register Address	Action R/WC	Size	Type	Units	Description
Wiring Type	90	R/WC	1	UInt16	-	0 = 1PH2W L-N 1 = 1PH2W L-L 2 = 3PH4W 3 = 3PH3W 4 = 1PH3W_LLN
Nominal Frequency	91	R/WC	1	UInt16	Hz	
VT Primary	92	R/WC	2	UInt32	V	
VT Secondary	94	R/WC	2	UInt32	V	RealValue=ReadValue/1000
CT Primary	96	R/WC	2	UInt32	A	
CT Secondary	98	R/WC	2	UInt32	mV	RealValue=ReadValue/1000
Rcoil Primary	100	R/WC	2	UInt32	A	
Rcoil Secondary	102	R/WC	2	UInt32	mV	RealValue=ReadValue/1000
Voltage Connection	104	R/WC	1	UInt16	-	0 = Direct Connect 1 = 3 VT
Current Connection	105	R/WC	1	UInt16	-	0 = Rogowski coil 1 = CT

### Digital Output Status

Register Alias	Register Address	Action R/WC	Size	Type	Units	Description
Digital Output Status	150	R/WC	1	-	-	1 = Relay output on 0 = Relay output off

### Tariff Status

Register Alias	Register Address	Action R/WC	Size	Type	Units	Description
<b>Tariff Status</b>	160	R/WC	1	-	-	1 = Tariff 1 2 = Tariff 2 3 = Tariff 3 4 = Tariff 4

### Command Register

Register Alias	Register Address	Action R/WC	Size	Type	Units	Description
Command Code	300	R/W	1	UInt16	-	
Parameter 001	301	R/W	1	UInt16	-	
Parameter 002	302	R/W	1	UInt16	-	
...	...	R/W	1	UInt16	-	

Parameter 123	423	R/W	1	UInt16	-	
Requested Command	424	R	1	UInt16	-	
Command Result	425	R	1	UInt16	-	0 = Valid Operation 80 = Invalid Command 81 = Invalid Parameter 82 = Invalid Number of Parameters 83 = Operation Not Performed

### Basic Data

#### Power factor ,frequency, harmonics, Current, voltage, power,

Register Alias	Register Address	Action R/WC	Size	Type	Units	Description
<b>Power Factor</b>						
PF1	2000	R	2	Float32	-	Phase 1 Power Factor
PF2	2002	R	2	Float32	-	Phase 2 Power Factor
PF3	2004	R	2	Float32	-	Phase 3 Power Factor
PF Avg	2006	R	2	Float32	-	Average Of PF1, PF2, PF3
DPF1	2008	R	2	Float32	-	Phase 1 Displacement Power Factor
DPF2	2010	R	2	Float32	-	Phase 2 Displacement Power Factor
DPF3	2012	R	2	Float32	-	Phase 3 Displacement Power Factor
DPF Avg	2014	R	2	Float32	-	Average Of DPF1,DPF2, DPF3
<b>Frequency</b>						
Freq1	2016	R	2	Float32	Hz	Phase 1 Frequency
Freq2	2018	R	2	Float32	Hz	Phase 2 Frequency
Freq3	2020	R	2	Float32	Hz	Phase 3 Frequency
FreqAvg	2022	R	2	Float32	Hz	Average of Freq1, Freq2, Freq3
<b>Harmonics Configuration</b>						
HX harmonic times	2024	R/WC	1	UInt16	-	Range:2-52
HY harmonic times	2025	R/WC	1	UInt16	-	Range:2-52
HZ harmonic times	2026	R/WC	1	UInt16	-	Range:2-52
<b>Current Harmonics</b>						
I1THDx	2027	R	2	Float32	%	Phase 1 X times harmonics current distortion
I2THDx	2029	R	2	Float32	%	Phase 2 X times harmonics current distortion
I3THDx	2031	R	2	Float32	%	Phase 3 X times harmonics current distortion
ITHDx Avg	2033	R	2	Float32	%	Average of I1THDx, I2THDx, I3THDx
I1THDy	2035	R	2	Float32	%	Phase 1 y times harmonics current distortion
I2THDy	2037	R	2	Float32	%	Phase 2 y times harmonics current

						distortion
I3THDy	2039	R	2	Float32	%	Phase 3 y times harmonics current distortion
ITHDy Avg	2041	R	2	Float32	%	Average of U1THDy, U2THDy, U3THDy
I1THDz	2043	R	2	Float32	%	Phase 1 z times harmonics current distortion
I2THDz	2045	R	2	Float32	%	Phase 2 z times harmonics current distortion
I3THDz	2047	R	2	Float32	%	Phase 3 z times harmonics current distortion
ITHDz Avg	2049	R	2	Float32	%	Average of U1THDz, U2THDz, U3THDz
I1THD	2051	R	2	Float32	%	Phase 1 total harmonics current distortion
I2THD	2053	R	2	Float32	%	Phase 2 total harmonics current distortion
I3THD	2055	R	2	Float32	%	Phase 3 total harmonics current distortion
ITHD Avg	2057	R	2	Float32	%	Average of U1THD, U2THD, U3THD
I1THx	2059	R	2	Float32	V	Phase 1 x times harmonics current
I2THx	2061	R	2	Float32	V	Phase 2 x times harmonics current
I3THx	2063	R	2	Float32	V	Phase 3 x times harmonics current
ITHx Avg	2065	R	2	Float32	V	Average of U1THx, U2THx, U3THx
I1THy	2067	R	2	Float32	V	Phase 1 y times harmonics current
I2THy	2069	R	2	Float32	V	Phase 2 y times harmonics current
I3THy	2071	R	2	Float32	V	Phase 3 y times harmonics current
ITHy Avg	2073	R	2	Float32	V	Average of U1THy, U2THy, U3THy
I1THz	2075	R	2	Float32	V	Phase 1 z times harmonics current
I2THz	2077	R	2	Float32	V	Phase 2 z times harmonics current
I3THz	2079	R	2	Float32	V	Phase 3 z times harmonics current
ITHz Avg	2081	R	2	Float32	V	Average of U1THz, U2THz, U3THz
<b>Voltage Harmonics</b>						
U1THDx	2083	R	2	Float32	%	Phase 1 X times harmonics voltage distortion
U2THDx	2085	R	2	Float32	%	Phase 2 X times harmonics voltage distortion
U3THDx	2087	R	2	Float32	%	Phase 3 X times harmonics voltage distortion
UTHDx Avg	2089	R	2	Float32	%	Average of U1THDx, U2THDx, U3THDx
U1THDy	2091	R	2	Float32	%	Phase 1 y times harmonics voltage distortion
U2THDy	2093	R	2	Float32	%	Phase 2 y times harmonics voltage distortion
U3THDy	2095	R	2	Float32	%	Phase 3 y times harmonics voltage

						distortion
UTHDy Avg	2097	R	2	Float32	%	Average of U1THDy, U2THDy, U3THDy
U1THDz	2099	R	2	Float32	%	Phase 1 z times harmonics voltage distortion
U2THDz	2101	R	2	Float32	%	Phase 2 z times harmonics voltage distortion
U3THDz	2103	R	2	Float32	%	Phase 3 z times harmonics voltage distortion
UTHDz Avg	2105	R	2	Float32	%	Average of U1THDz, U2THDz, U3THDz
U1THD	2107	R	2	Float32	%	Phase 1 total harmonics voltage distortion
U2THD	2109	R	2	Float32	%	Phase 2 total harmonics voltage distortion
U3THD	2111	R	2	Float32	%	Phase 3 total harmonics voltage distortion
UTHD Avg	2113	R	2	Float32	%	Average of U1THD, U2THD, U3THD
U1THx	2115	R	2	Float32	V	Phase 1 x times harmonics voltage
U2THx	2117	R	2	Float32	V	Phase 2 x times harmonics voltage
U3THx	2119	R	2	Float32	V	Phase 3 x times harmonics voltage
UTHx Avg	2121	R	2	Float32	V	Average of U1THx, U2THx, U3THx
U1THy	2123	R	2	Float32	V	Phase 1 y times harmonics voltage
U2THy	2125	R	2	Float32	V	Phase 2 y times harmonics voltage
U3THy	2127	R	2	Float32	V	Phase 3 y times harmonics voltage
UTHy Avg	2129	R	2	Float32	V	Average of U1THy, U2THy, U3THy
U1THz	2131	R	2	Float32	V	Phase 1 z times harmonics voltage
U2THz	2133	R	2	Float32	V	Phase 2 z times harmonics voltage
U3THz	2135	R	2	Float32	V	Phase 3 z times harmonics voltage
UTHz Avg	2137	R	2	Float32	V	Average of U1THz, U2THz, U3THz
<b>Current</b>						
I1	2139	R	2	Float32	A	Phase 1 Current
I2	2141	R	2	Float32	A	Phase 2 Current
I3	2143	R	2	Float32	A	Phase 3 Current
Current Avg	2145	R	2	Float32	A	Average of I1, I2, I3
<b>Voltage</b>						
U1	2147	R	2	Float32	V	Phase 1 Voltage
U2	2149	R	2	Float32	V	Phase 2 Voltage
U3	2151	R	2	Float32	V	Phase 3 Voltage
Voltage Avg	2153	R	2	Float32	V	Average of U1, U2, U3
<b>Power</b>						
P1	2155	R	2	Float32	kW	Active Power Phase 1
P2	2157	R	2	Float32	kW	Active Power Phase 1
P3	2159	R	2	Float32	kW	Active Power Phase 1
PTotal	2161	R	2	Float32	kW	Total Active Power

FQ1	2163	R	2	Float32	kVAR	Fundamental Reactive Power Phase 1
FQ2	2165	R	2	Float32	kVAR	Fundamental Reactive Power Phase 2
FQ3	2167	R	2	Float32	kVAR	Fundamental Reactive Power Phase 3
FQTotal	2169	R	2	Float32	kVAR	Total Fundamental Reactive Power
S1	2171	R	2	Float32	kVA	Apparent Power Phase 1
S2	2173	R	2	Float32	kVA	Apparent Power Phase 2
S3	2175	R	2	Float32	kVA	Apparent Power Phase 3
STotal	2177	R	2	Float32	kVA	Total Apparent Power

## Energy

The energy values automatically resets to 0 when total energy reaches the limit of  $1.0 \times 10^9$  kWh,  $1.0 \times 10^9$  kVarh, or  $1.0 \times 10^9$  kVAh

Energy values						
Register Alias	Register Address	Action R/W/C	Size	Type	Units	Description
<b>Active Energy</b>						
EP1Imp	4000	R	2	UInt32	kWh	Active Energy Import Phase 1
EP2Imp	4002	R	2	UInt32	kWh	Active Energy Import Phase 2
EP3Imp	4004	R	2	UInt32	kWh	Active Energy Import Phase 3
EPsumImp	4006	R	2	UInt32	kWh	Total Active Energy Import Phase All
EP1Exp	4008	R	2	UInt32	kWh	Active Energy Export Phase 1
EP2Exp	4010	R	2	UInt32	kWh	Active Energy Export Phase 2
EP3Exp	4012	R	2	UInt32	kWh	Active Energy Export Phase 3
EPsumExp	4014	R	2	UInt32	kWh	Total Active Energy Export Phase All
<b>Reactive Energy</b>						
EQ1Imp	4024	R	2	UInt32	kVarh	Reactive Energy Import Phase 1
EQ2Imp	4026	R	2	UInt32	kVarh	Reactive Energy Import Phase 2
EQ3Imp	4028	R	2	UInt32	kVarh	Reactive Energy Import Phase 3
EQsumImp	4030	R	2	UInt32	kVarh	Total Reactive Energy Import Phase All
EQ1Exp	4032	R	2	UInt32	kVarh	Reactive Energy Export Phase 1
EQ2Exp	4034	R	2	UInt32	kVarh	Reactive Energy Export Phase 2
EQ3Exp	4036	R	2	UInt32	kVarh	Reactive Energy Export Phase 3
EQsumExp	4038	R	2	UInt32	kVarh	Total Reactive Energy Export Phase All
<b>Apparent Energy</b>						
ES1Imp	4048	R	2	UInt32	kVAh	Apparent Energy Import Phase 1
ES2Imp	4050	R	2	UInt32	kVAh	Apparent Energy Import Phase 2
ES3Imp	4052	R	2	UInt32	kVAh	Apparent Energy Import Phase 3
ESsumImp	4054	R	2	UInt32	kVAh	Total Apparent Energy Import Phase All
ES1Exp	4056	R	2	UInt32	kVAh	Apparent Energy Export Phase 1
ES2Exp	4058	R	2	UInt32	kVAh	Apparent Energy Export Phase 2
ES3Exp	4060	R	2	UInt32	kVAh	Apparent Energy Export Phase 3
ESsumExp	4062	R	2	UInt32	kVAh	Total Apparent Energy Export Phase All

Energy by Tariff Import						
ETF1	4072	R	2	UInt32	kWh	Rate 1 Active Energy Import
ETF2	4074	R	2	UInt32	kWh	Rate 2 Active Energy Import
ETF3	4076	R	2	UInt32	kWh	Rate 3 Active Energy Import
ETF4	4078	R	2	UInt32	kWh	Rate 4 Active Energy Import
Power/Current Demand						
PDemand	5000	R	2	Float32	kW	Active Power Present Demand
PPeakDemand	5002	R	2	Float32	kW	Active Power Peak Demand
PPeakDemandDate	5004	R	4	Date time	-	Active Power Peak Demand Date/Time
QDemand	5008	R	2	Float32	kW	Reactive Power Present Demand
QPeakDemand	5010	R	2	Float32	kW	Reactive Power Peak Demand
QPeakDemandDate	5012	R	4	Date time	-	Reactive Power Peak Demand Date/Time
SDemand	5016	R	2	Float32	kW	Apparent Power Present Demand
SPeakDemand	5018	R	2	Float32	kW	Apparent Power Peak Demand
SPeakDemandDate	5020	R	4	Date time	-	Apparent Power Peak Demand Date/Time
I1Demand	5024	R	2	Float32	kW	Current I1 Present Demand
I1PeakDemand	5026	R	2	Float32	kW	Current I1 Peak Demand
I1PeakDemandDate	5028	R	4	Date time	-	Current I1 Peak Demand Date/Time
I2Demand	5032	R	2	Float32	kW	Current I2 Present Demand
I2PeakDemand	5034	R	2	Float32	kW	Current I2 Peak Demand
I2PeakDemandDate	5036	R	4	Date time	-	Current I2 Peak Demand Date/Time
I3Demand	5040	R	2	Float32	kW	Current I3 Present Demand
I3PeakDemand	5042	R	2	Float32	kW	Current I3 Peak Demand
I3PeakDemandDate	5044	R	4	Date time	-	Current I3 Peak Demand Date/Time
IAvgDemand	5048	R	2	Float32	kW	Current IAvg Present Demand
IAvgPeakDemand	5050	R	2	Float32	kW	Current IAvg Peak Demand
IAvgPeakDemand Date	5052	R	4	Date time	-	Current IAvg Peak Demand Date/Time

## Harmonics calculations

The power quality analysis values use the following abbreviations:

- Fundamental phase current rms: I1
- Fundamental phase voltage rms: V1
- Total harmonic distortion of the phase current

$$(THD)_I = \frac{\sqrt{I^2 - I_1^2}}{I_1}$$

- Total harmonic distortion of the phase voltage



$$(\text{THD})_V = \frac{\sqrt{V^2 - V_1^2}}{V_1}$$

- Harmonic distortion on the phase current

$$HD_{I_x} = \frac{I_x}{I_1}, x = 2, 3, \dots, N$$

$$HD_{I_y} = \frac{I_y}{I_1}, y = 2, 3, \dots, N$$

$$HD_{I_z} = \frac{I_z}{I_1}, z = 2, 3, \dots, N$$

- Harmonic distortion on the phase voltage

$$HD_{V_x} = \frac{V_x}{V_1}, x = 2, 3, \dots, N$$


$$HD_{V_y} = \frac{V_y}{V_1}, y = 2, 3, \dots, N$$

$$HD_{V_z} = \frac{V_z}{V_1}, z = 2, 3, \dots, N$$

## Power, energy and power factor

### Power and the PQ coordinate system

The meter uses the values of real power (P) and reactive power (Q) on the PQ coordinate system to calculate apparent power

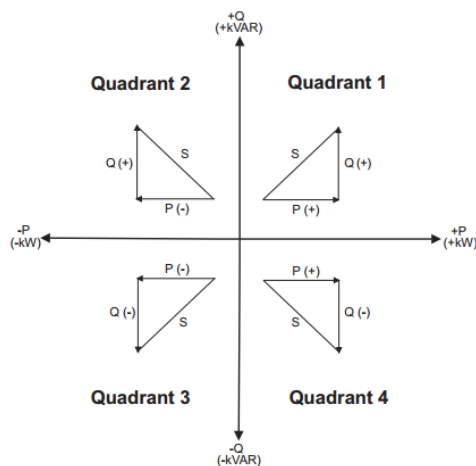

### Power flow

Positive power flow P(+) and Q(+) means power is flowing from the power source towards the load. Negative power flow P(-) and Q(-) means power is flowing from the load towards the power source.

### Energy delivered (imported) / energy received (exported)

The meter interprets energy delivered (imported) or received (exported) according to the direction of real power (P) flow. Energy delivered (imported) means positive real power flow (+P) and energy

received(exported) means negative real power flow (-P).

### Power factor (PF)

Power factor (PF) is the ratio of real power (P) to apparent power (S), and is a number between 0 and 1. An ideal, purely resistive load has no reactive components, so its power factor is one (PF = 1, or unity power factor). A purely inductive or capacitive load no resistive components, so its power factor is zero (PF = 0).

### True PF and displacement PF

The meter supports true power factor and displacement power factor values:

- True power factor includes harmonic content(PF).
- Displacement power factor only considers the fundamental frequency(DPF).


### PF sign convention

The meter shows positive or negative power factor according to IEC standards.

### PF sign in IEC mode

The meter correlates power factor sign (PF sign) with the direction of real power (P)flow.

- For positive real power (+P), the PF sign is positive (+).
- For negative real power (-P), the PF sign is negative (-).

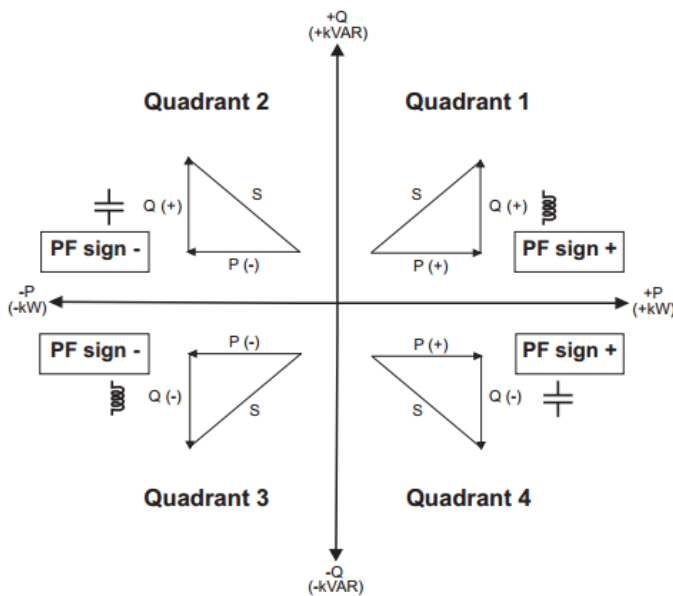

Doc Rev. :

Revision	Description	Date	Reviser
V3.3	Fixed default communication setting Revised "VT Secondary", "CT Secondary", "Rcoil Secondary" registers Revised "Power System" registers address	20180825	Walter
V3.4	Revised Energy registers data type from float32 to UInt32	20181102	Walter

	Revised Energy registers data unit from Wh to kWh Revised tariff to 4 rates deleted 64-bit energy registers Added function code 3 and 16 operation guide		
--	---	--	--

**Shanghai PINYAN M&C Technology Co., Ltd.**

T: +86 21 64850006

F: +86 21 64850006

E: info@meatrol.cn

W: www.meatrol.cn